

Certificate of Registration

No: ENRE00276305

This registration certificate is issued by the Environmental Protection Agency.
This registration certificate takes effect from: 26-MAY-2005


The anniversary day for the purpose of the Annual Return is: 01 October each year

This registration certificate is a requirement of section 73F of the *Environmental Protection Act 1994* and authorises the registered operator to undertake the activity listed below at the following place, subject to the conditions of the Development Approval listed below or the relevant code of environmental compliance.

TAKE NOTICE: The granting of this registration certificate does not exempt the registered operator from the need to obtain such other approvals as may be required under other legislation.

Registered Operator: -

Yarrabah Community Council
Sawmill Road
YARRABAH QLD 4871

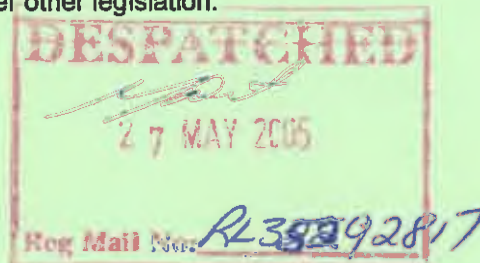

Registered Place & Activities:

Development Approval No	Place	Located at	ERA
5010000070 (FN0070)	NR7310, Parish of Trinity, County of Nares	Yarrabah - STP King Beach Road, YARRABAH	ERA 15(c) Sewage treatment - operating - a standard sewerage treatment works having a peak design capacity to treat sewage of 1 500 or more equivalent persons but less than 4 500 equivalent persons.
5010000070 (FN0070)	NR7310, Parish of Trinity, County of Nares	Yarrabah Aquaculture Farm, King Beach Road, YARRABAH	ERA 1(b) Aquaculture - cultivating or holding marine, estuarine or freshwater organisms (other than molluscs) in ponds or tanks or in enclosures in waters ("impoundments") - if the total area of the impoundments is less than 5 ha and wastes are released to waters.

Development Approval No	Place	Located at	ERA
5010000070 (FN0070)	NR7310, Parish of Trinity, County of Nares	Yarrabah - Tip, Workshop Street, YARRABAH	ERA 75(a)(ii) Waste disposal - operating a facility for -disposing of only general waste or limited regulated waste, if the facility is designed to receive waste at the rate of more than 2 000 t but not more than 5 000 t a year.
FN0462	Lot 185, NR7310, Parish of Trinity, County of Nares	Community Council Depot, Workshop Street, YARRABAH	ERA 28 Motor vehicle workshop - operating a workshop or mobile workshop in the course of which motor vehicle mechanical or panel repairs are carried out in the course of a commercial or municipal enterprise (other than on a farm or under a mining tenement) or on a commercial basis.

Mark Cavicchiolo

Mark Cavicchiolo
Operations Manager
Cairns District, Northern Region
Delegate
Environmental Protection Agency

26-MAY-2005

500705

5.6.98

CNS 1471

Our reference:

500 274, 500 685, 500 705

✓ CARMS

Environmental Protection Act 1994**LICENCE No. 5010000070 (Amended)****Section 45(1)**

Under the provisions of the *Environmental Protection Act 1994* this environmental is issued:

To: Yarrabah Community Council
Address: Sawmill Road
YARRABAH QLD 4871



in respect of carrying out the environmentally relevant activity/ies at the following place(s):

Yarrabah Sewage Treatment Plant
NR7310
Parish of Trinity, County of Nares
located at:
King Beach Road,
YARRABAH QLD 4871



- ERA 15(c) Sewage treatment -1,500 equivalent persons or more but <4,000

Yarrabah Tip
NR7310
Parish of Trinity, County of Nares
located at:
Workshop Street
YARRABAH QLD 4871

- ERA 75(a)(ii) Waste disposal facility for general waste and limited regulated waste 2,000t or more but less than 5,000t per year

Yarrabah Aquaculture Farm
NR7310
Parish of Trinity, County of Nares
located at:
King Beach Road
YARRABAH QLD 4871

- ERA 1(b) Aquaculture - less than 5 hectares, wastes released

Environmental Authority #
5010000070 (Amended)

Env. Authority Holder
Yarrabah Community Council

Section 45(1)

This environmental authority is issued subject to the conditions set out in the schedules attached to this environmental authority.

This amended licence takes effect from 23 June 1998.

signed



.....
Ron Anderson
Regional Manager (Environment), FNR
Delegate of Administering Authority
Environmental Protection Act 1994

date

5 June 1998

Section 45(1)

This environmental authority consists of the following schedules:

PART 1 - GENERAL CONDITIONS APPLICABLE TO ALL LICENSED PLACES

SCHEDULE 1.A	-	GENERAL CONDITIONS
SCHEDULE 1.B	-	AIR
SCHEDULE 1.C	-	WATER
SCHEDULE 1.D	-	STORMWATER MANAGEMENT
SCHEDULE 1.E	-	LAND APPLICATION
SCHEDULE 1.F	-	NOISE
SCHEDULE 1.G	-	WASTE MANAGEMENT
SCHEDULE 1.H	-	MONITORING AND REPORTING
SCHEDULE 1.I	-	DEFINITIONS
SCHEDULE 1.J	-	SITE PLAN

PART 2 - YARRABAH SEWAGE TREATMENT PLANT

SCHEDULE 2.A	-	GENERAL CONDITIONS
SCHEDULE 2.B	-	AIR
SCHEDULE 2.C	-	WATER
SCHEDULE 2.D	-	STORMWATER MANAGEMENT
SCHEDULE 2.E	-	LAND APPLICATION
SCHEDULE 2.F	-	NOISE
SCHEDULE 2.G	-	WASTE MANAGEMENT
SCHEDULE 2.H	-	MONITORING AND REPORTING
SCHEDULE 2.I	-	DEFINITIONS
SCHEDULE 2.J	-	SITE PLANS

Section 45(1)

PART 3 - YARRABAH TIP

SCHEDULE 3.A	-	GENERAL CONDITIONS
SCHEDULE 3.B	-	AIR
SCHEDULE 3.C	-	WATER
SCHEDULE 3.D	-	STORMWATER MANAGEMENT
SCHEDULE 3.E	-	LAND APPLICATION
SCHEDULE 3.F	-	NOISE
SCHEDULE 3.G	-	WASTE MANAGEMENT
SCHEDULE 3.H	-	MONITORING AND REPORTING
SCHEDULE 3.I	-	DEFINITIONS
SCHEDULE 3.J	-	SITE PLAN

PART 4 - YARRABAH AQUACULTURE FARM

SCHEDULE 4.A	-	GENERAL CONDITIONS
SCHEDULE 4.B	-	AIR
SCHEDULE 4.C	-	WATER
SCHEDULE 4.D	-	STORMWATER MANAGEMENT
SCHEDULE 4.E	-	LAND APPLICATION
SCHEDULE 4.F	-	NOISE
SCHEDULE 4.G	-	WASTE MANAGEMENT
SCHEDULE 4.H	-	MONITORING AND REPORTING
SCHEDULE 4.I	-	DEFINITIONS

Section 45(1)

PART 1 - CONDITIONS APPLICABLE TO ALL LICENSED PLACES

SCHEDULE 1.A - GENERAL CONDITIONS

Access to Environmental Authority, Integrated Environmental Management System, Site Based Management Plans and Site Development Plans

- (1.A1) A copy of this environmental authority and any associated plans must be kept in a location readily accessible to personnel carrying out the environmentally relevant activity.

Records

- (1.A2) Any record or document required to be kept by a condition of this environmental authority must be kept at the council offices for a period of at least five (5) years and be available for examination by an authorised person. For daily and weekly records, the record retention requirements of this condition will be satisfied if any daily and weekly records are kept for a period of at least three (3) years and these records are then kept in the form of annual summaries after that period.

Alterations

- (1.A3) No change, replacement or operation of any plant or equipment is permitted if the change, replacement or operation of the plant or equipment increases, or is likely to substantially increase, the risk of environmental harm above that expressly provided by this environmental authority.

An example of a substantial increase in the risk of environmental harm is an increase of 10% or more in the quantity of the contaminant to be released into the environment.

Monitoring and Measurements

- (1.A4) All determinations of the quality of contaminants released to the environment and all measurement and reporting of noise levels that are required by this environmental authority must be undertaken by a person or body possessing appropriate experience and qualifications to perform the required determinations and the required measurements.

Calibration

- (1.A5) All instruments and devices used for the measurement or monitoring of any parameter under any condition of this environmental authority must be calibrated, and appropriately operated and maintained.

Due Regard for Comment

- (1.A6) Where any plan or program is required as a condition of this environmental authority to be submitted to the administering authority for review and comment, the holder of this environmental authority must have due regard to those comments in the finalisation of that plan or program.

Section 45(1)

Integrated Environmental Management System (IEMS)

(1.A7) The holder of this environmental authority must:

- (a) develop and implement an IEMS which provides for the following functions:
 - (i) the monitoring of releases of contaminants into the environment and an environmental assessment of the releases; and
 - (ii) staff training and awareness of environmental issues to ensure that, at the minimum:
 - (a) any person responsible for carrying out any of the environmentally relevant activities is familiar with the conditions of this environmental authority as they relate to the person's responsibilities; and
 - (b) any person responsible for the operation and maintenance of plant and equipment used in carrying out the environmentally relevant activities is competent to carry out their duties; and
 - (iii) the conduct of environmental and energy audits; and
 - (iv) waste prevention, treatment and disposal; and
 - (v) a program for continuous improvement; and
 - (vi) reporting arrangements on the effectiveness of the environmental management of the activities; and
 - (vii) preparation and implementation of Site Based Management Plans for each licensed place covered by this environmental authority; and
- (b) lodge with the administering authority on or before 31 August 1998 and at three (3) monthly intervals thereafter until 28 February 1999 a brief report describing the progress in developing and implementing the IEMS; and
- (c) on or before 31 May 1999 lodge a detailed description of the IEMS and its documentation with the administering authority for its review and comment; and
- (d) have due regard to that comment in the finalisation of the IEMS; and
- (e) on or before 31 August 1999 have completed and implemented the IEMS.

Section 45(1)

Site Based Management Plans

- (1.A8) Site Based Management Plans required by this environmental authority must provide for at least the following functions:
- (a) routine operating procedures to prevent or minimise environmental harm from the carrying out of the environmentally relevant activity and include procedures for the recovery, storage and proper disposal of any wastes found at the Yarrabah Tip which are not allowed to be disposed of at that site; and
 - (b) maintenance practices and procedures to ensure that all plant, equipment and reticulation systems used in the carrying out of the environmentally relevant activities are maintained in good working order; and
 - (c) contingency plans and emergency procedures to deal with foreseeable risks and hazards including inspection procedures and response plans for sewage pump stations in the event of failure of the power supply to any pump station; and
 - (d) recording and handling of environmental complaints; and
 - (e) preparation and carrying out of monitoring programs to ensure compliance with the conditions of this environmental authority; and
 - (f) monitoring of compliance with any of the requirements of:
 - (i) the conditions of this environmental authority; and
 - (ii) any plans or programs prepared under this environmental authority; and
 - (g) review and amendment or improvement of operating procedures and plans or programs required under this Site Based Management Plan where deficiencies are revealed by the monitoring program required in section (f) of this condition; and
 - (h) any other specific requirements of the other parts of this environmental authority.

END OF CONDITIONS FOR SCHEDULE 1.A

SCHEDULE 1.B - AIR

- (1.B1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 1.B

SCHEDULE 1.C - WATER

- (1.C1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 1.C

Section 45(1)

SCHEDULE 1.D - STORMWATER MANAGEMENT

(1.D1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 1.D

SCHEDULE 1.E - LAND APPLICATION

(1.E1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 1.E

SCHEDULE 1.F - NOISE

Emission of Noise

(F1) In the event of a complaint about unreasonable noise generated on the licensed place, that the administering authority considers to be neither frivolous or vexatious, then the holder of this environmental authority must take action to ensure that the noise is no longer an unreasonable noise.

END OF CONDITIONS FOR SCHEDULE 1.F

SCHEDULE 1.G - WASTE MANAGEMENT

Off Site Movement of Regulated Wastes

(1.G1) Where regulated waste is removed from any licensed place (other than by a release as permitted under another schedule of this environmental authority), the holder of this environmental authority must ensure that records are kept of the following:

- (a) the date, quantity and type of waste removed; and
- (b) name of the waste transporter that removed the waste; and
- (c) the intended treatment/disposal destination of the waste.

Note: Records of documents maintained in compliance with a waste tracking system established under the *Environmental Protection Act 1994* or any other law for regulated waste will be deemed to satisfy this condition of this environmental authority.

END OF CONDITIONS FOR SCHEDULE 1.G

SCHEDULE 1.H - MONITORING AND REPORTING

Sampling and Analysis of Waters

(1.H1) All determinations of the quality of leachate, contaminants released to waters must be made in accordance with methods prescribed in the Department of Environment and Heritage Water Quality Sampling Manual, 2nd Edition, February 1995, or more recent additions or supplements to that document as such become available.

Section 45(1)

Recording of Monitoring Program Results

- (1.H2) The holder of this environmental authority must keep a written record of the results of all monitoring programs required under this environmental authority. This record must:
- (a) record the results of all analyses, measurements and observations;
 - (b) record the date and time of sampling; and
 - (c) have all records of analyses, measurements and observations signed by a responsible officer.

Annual Monitoring Report

- (1.H3) The holder of this environmental authority must submit a report to the administering authority with the annual return which shall include but not be limited to:
- (a) a summary of the previous twelve (12) month's monitoring results obtained under any monitoring program(s) required under this environmental authority; and
 - (b) a summary of any record of quantities of discharge required to be kept under this environmental authority; and
 - (c) for the sewage treatment plant:
 - (i) the number of domestic tenements newly connected to the sewage treatment works during the previous twelve (12) months; and
 - (ii) the progressive total number of connections; and
 - (iii) a summary of any trade waste agreements entered into or amended during the year, including the nature of the industry.

Exception Reporting

- (1.H4) The holder of this environmental authority must, unless a program notice in accordance with Section 101 of the Act is submitted, notify the administering authority in writing of any monitoring result which indicates an exceedance of any environmental authority limit within twenty-eight (28) days of completion of analysis.
- (1.H5) The written notification required by condition number (1.H4) above must include:
- (a) the full analysis results; and
 - (b) details of investigation or corrective actions taken; and
 - (c) results of any subsequent analysis carried out to verify the success of any corrective actions taken.
- (1.H6) If a program notice has been submitted under Section 101 of the Act, condition numbers (1.H4) and (1.H5) will have been complied with if the required information is submitted by the date specified in a Section 103 notice requiring submission of a draft Environmental Management Program.

END OF CONDITIONS FOR SCHEDULE 1.H

Section 45(1)

SCHEDULE 1.1 - DEFINITIONS

For the purposes of this environmental authority the following definitions apply:

- (1.11) "administering authority" means the Department of Environment or its successor.
- (1.12) "total nitrogen" means the sum of Organic Nitrogen, Ammonia Nitrogen, Nitrite plus Nitrate Nitrogen.
- (1.13) "mg/l" means milligrams per litre.
- (1.14) "annual average" is the arithmetic average calculated using twelve (12) months consecutive results for the characteristic.
- (1.15) "quarterly" means in the first week of each of March, June, September and December.
- (1.16) "grab" sample means one sample collected at any point in time.
- (1.17) "median" means the middle value, where half the data are smaller, and half the data are larger. If the number of samples is even, the median is the arithmetic average of the two middle values.
- (1.18) "maximum" means that the measured value of the quality characteristic or contaminant must not be greater than the release limit stated.
- (1.19) "minimum" means that the measured value of the quality characteristic or contaminant must not be less than the release limit stated.
- (1.110) "range" means that the measured value of the quality characteristic or contaminant must not be greater than the higher release limit stated nor lower than the lower release limit stated.
- (1.111) "permeability" means a measure of the rate at which a fluid will pass through a medium. The coefficient of permeability of a given fluid is an expression of the rate of flow through unit area and thickness under unit differential pressure at a given temperature. Synonymous with hydraulic conductivity when the fluid is water.
- (1.112) "leachate" means contaminated water which has been generated in or percolated through or drained from wastes.
- (1.113) "compaction" means increasing the density of solid waste in landfills by the repeated passage of heavy machinery over its surface.
- (1.114) "cover" means material used to cover wastes deposited in landfills or sanitary depots.
- (1.115) "leachate recirculation" means the practice of returning leachate to the upper layers of a landfill, from which it has been abstracted, usually by direct spraying or pump well injection.
- (1.116) "capping" means the covering of a landfill or sanitary depot trench with impervious material to inhibit penetration by liquids.
- (1.117) "future waste disposal area" means any waste disposal area constructed after this environmental authority takes effect.

Section 45(1)


- (1.118) "waste disposal activities" means all activities relating to waste disposal and includes the shredding of waste (where applicable), stockpiling of cover material, temporary waste storage, leachate collection and disposal, litter control and cell, trench or disposal area construction.
- (1.119) "licensed places" means all the licensed places listed individually in the other parts of this environmental authority.
- (1.120) "the holder of this environmental authority" means Yarrabah Community Council.

END OF CONDITIONS FOR SCHEDULE 1.I

Section 45(1)

SCHEDULE 1.J - SITE PLAN

(1.J1) Location of licensed places.

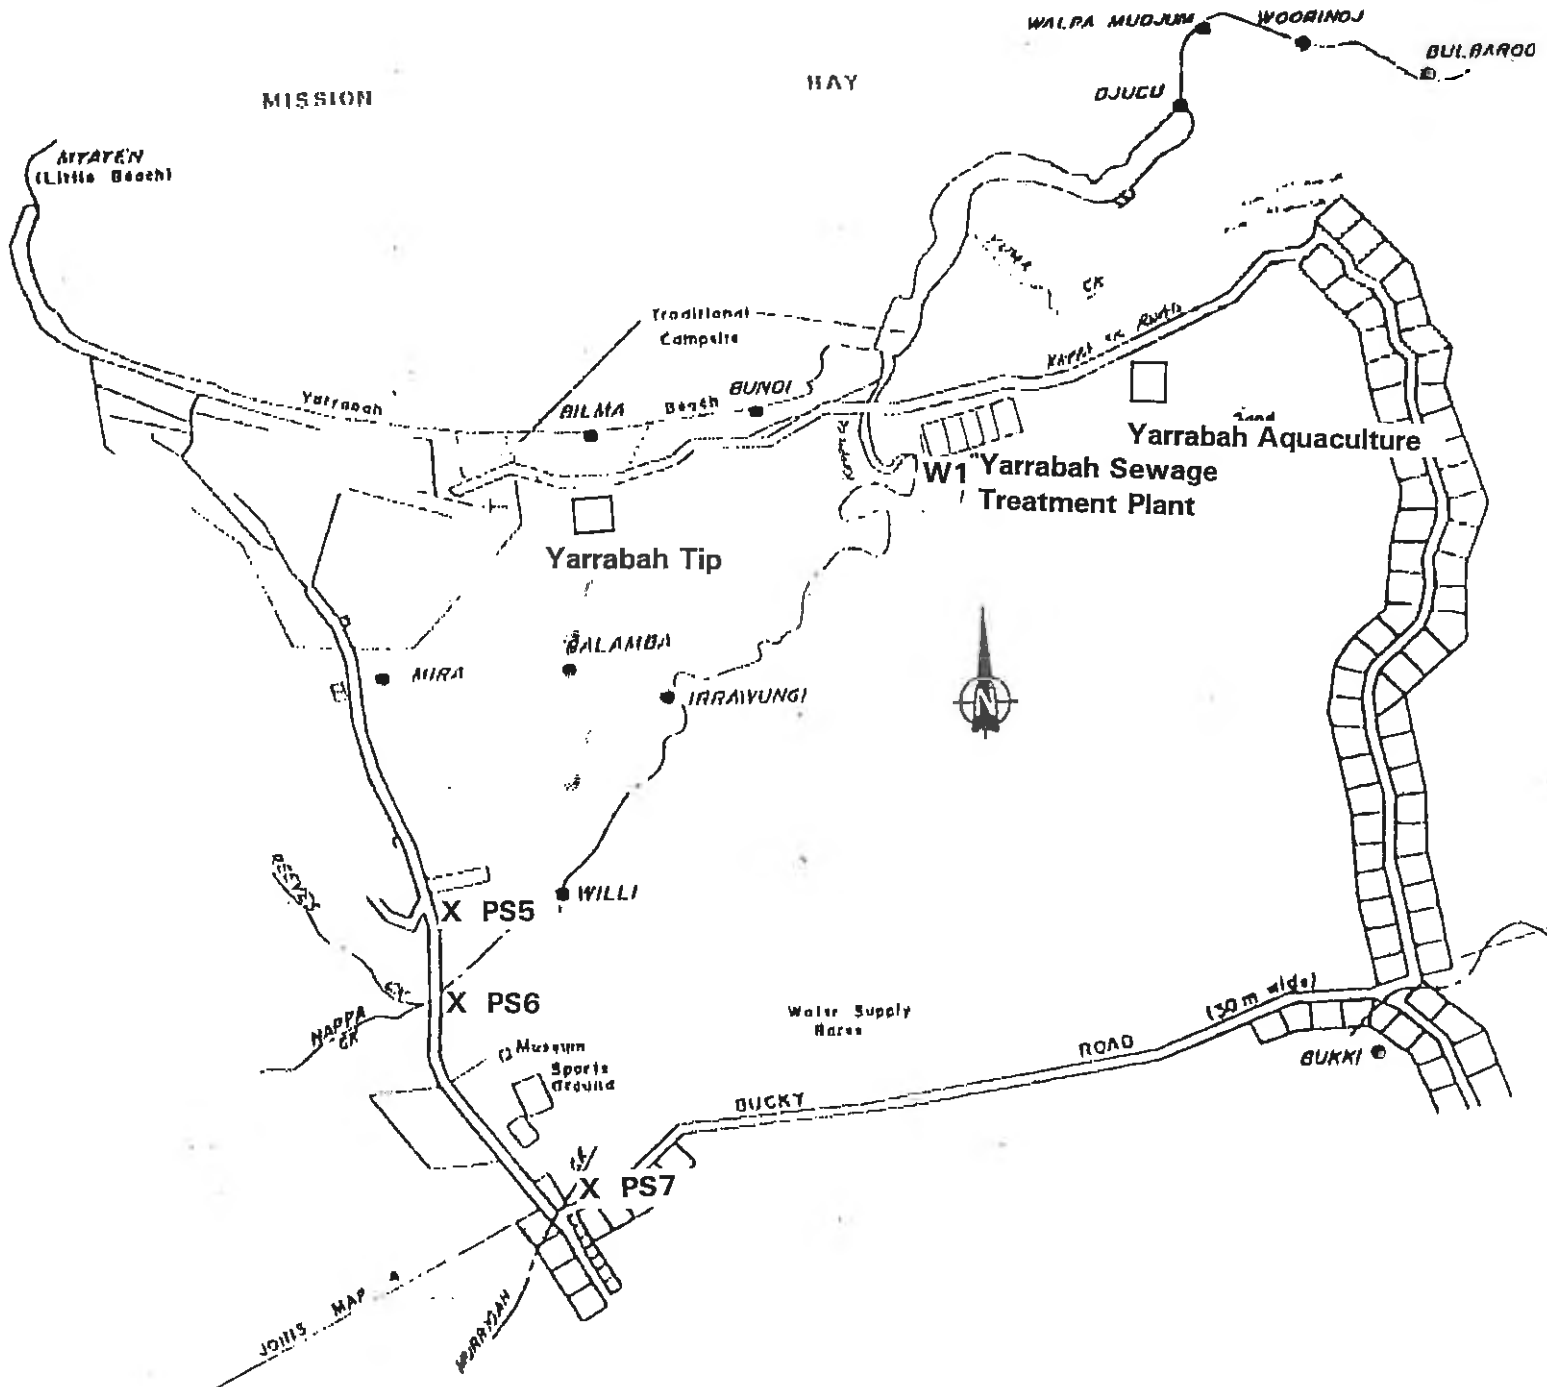

END OF CONDITIONS FOR SCHEDULE 1.J

Section 45(1)

PART 2 - YARRABAH SEWAGE TREATMENT PLANT

SCHEDULE 2.A - GENERAL CONDITIONS

(2.A1) Nil conditions

END OF CONDITIONS FOR SCHEDULE 2.A

SCHEDULE 2.B - AIR

(2.B1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 2.B

SCHEDULE 2.C - WATER

Release Points

- (2.C1) Sewage or treated sewage effluent must not be directly or indirectly released from any source on the licensed place to any waters or land at any location other than:
- (a) overflows from sewage pump stations in accordance with the requirements of this environmental authority; or
 - (b) the discharge of treated effluent from Release Point W1 to Kappa Creek at a point approximately 0.6 km AMTD.

Quantity of Contaminants Released

- (2.C2) The total quantity of contaminants released from Release Point W1 during any dry weather day must not exceed 460 cubic metres.

Quality Characteristics of Release to Waters

- (2.C3) The release of contaminants to waters from Release Point W1 must comply, at the sampling and in situ monitoring point specified in condition number (2.H2), with each of the limits specified in Schedule 2.C - Table 1 for each quality characteristic.

Schedule 2.C - Table 1 - Release Quality Characteristic Limits

Quality Characteristics	Release Limit	Limit Type
5-day Biochemical Oxygen Demand (mg/l)	20 60	annual average maximum
Suspended Solids (mg/l)	60 180	annual average maximum
pH (pH Units)	6.5 to 8.5	range
Dissolved Oxygen (mg/l)	2	minimum
Faecal Coliforms (Organisms /100 ml)	tbs tbs	median ⁽¹⁾ 80th percentile ⁽²⁾
Ammonia Nitrogen (mg/l)	1	maximum

Section 45(1)

Notes:

"tbs" means to be specified following consideration of the results of studies yet to be carried out.

⁽¹⁾ Median for this quality characteristic must be based on the results of at least five samples, with individual samples being collected at intervals of not less than thirty (30) minutes.

⁽²⁾ "80th percentile" for this quality characteristic means that the measured values of the quality characteristic must not be greater than the release limit for any more than one out of five consecutive samples.

- (2.C4) The release of contaminants to waters from Release Point W1 must not produce visible floating oil, grease, scum or litter.

Pump Station Overflows

- (2.C5) The only pump stations permitted to release contaminants to any waters are those listed below at the corresponding overflow locations:

Pump Station Description	Pump station location	Overflow location
PS1	Workshop Street	to swamp south of Workshop Street
PS2	End of Gribble Street	to Yarrabah Beach, Mission Bay
PS3	Workshop Street	to Yarrabah Beach, Mission Bay
PS4	Beach Street	to Yarrabah Beach, Mission Bay
PS5	Back Beach Road	to swamp east of Back Beach Road
PS6	Stonewig Close	to Kappa Creek
PS7	Bucky Road	to Murrigan Creek

Sewage Pump Station Alarms and Standby Pump Systems

- (2.C6) Sewage pump stations whose failure would or would be likely to result in a direct or indirect release of contaminants to waters must be fitted with stand-by pumps and pump-failure alarms as well as high level alarms to warn of imminent pump station overflow. All alarms must be able to operate without mains power if such power failure occurs and must contact the appropriate person to respond to the alarm.

Screening of Sewage Pump Station Overflows

- (2.C7) All sewage pump station overflows must be screened to prevent the release of gross solids.

Section 45(1)

Sewage Pump Stations

- (2.C8) Any new sewage pump station installed by the holder of this environmental authority must comply with the following design criteria:
- (a) overflows resulting from infiltration should not occur for less than five (5) times design ADWF;
 - (b) all overflows and overflow control structures must, where practicable, be located away from environmentally sensitive locations including waterways and natural wetlands;
 - (c) retention basins with at least twenty four (24) hours capacity at design ADWF must be installed to isolate and contain sewage pump station overflows; and
 - (d) where a retention basin is provided, the contained overflow must be able to be pumped back to the sewage treatment system or removed for off site disposal.

END OF CONDITIONS FOR SCHEDULE 2.C

SCHEDULE 2.D - STORMWATER MANAGEMENT

- (2.D1) The licensed place must be operated in such a way that contamination of stormwater is avoided or minimised by:
- (a) diversion of upstream runoff away from areas containing wastes or contaminants including the sewage treatment lagoons; and
 - (b) maintenance of any diversion drains around treatment lagoons to minimise any undermining or erosion of embankments; and
 - (c) minimisation of the size of contaminated areas; and
 - (d) if soil is to be exposed or disturbed as a result of any works associated with the licensed place:
 - (i) minimisation of the amount of soil to be exposed or disturbed by staging works; and
 - (ii) revegetation or stabilisation of exposed or disturbed areas; and
 - (iii) installation of sediment control measures such as silt fences and settling basins; and
 - (iv) diversion of upstream runoff from exposed or disturbed areas.

END OF CONDITIONS FOR SCHEDULE 2.D

SCHEDULE 2.E - LAND APPLICATION

- (2E.1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 2.E

Section 45(1)

SCHEDULE 2.F - NOISE

- (2.F1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 2.F

SCHEDULE 2.G - WASTE MANAGEMENT

Acceptance of Regulated Wastes

- (2.G1) The holder of this environmental authority may only accept regulated waste into the sewerage system serving the licensed place when such wastes are commingled with normal domestic sewage or in accordance with a trade waste policy.

Sludge Removal and Handling

- (2.G2) The holder of this environmental authority must remove any sludges from the sewage treatment plant in a manner that minimises the risk of spillage of sludge or any other release of contaminants to the environment.

Infiltration Management

- (2.G3) The holder of this environmental authority must maintain the sewage reticulation system in such a manner that infiltration and other stormwater inflows are minimised.

Trade Waste Agreements

- (2.G4) Records of any trade waste agreements for discharge of wastes to sewers must be made available for inspection on request.

END OF CONDITIONS FOR SCHEDULE 2.G

SCHEDULE 2.H - MONITORING AND REPORTING

Monitoring of Contaminant Releases to Waters

- (2.H1) The holder of this environmental authority is responsible for the making of determinations and keeping of records of the quality of the contaminants released from Release Point W1 for the quality characteristics and at the frequency specified in Schedule 2.H - Table 1.

Sampling Point

- (2.H2) The holder of this environmental authority must provide and maintain a sampling point for the treated sewage effluent in the discharge line from the sewage treatment plant to Kappa Creek. This sampling point must be maintained so as to be readily accessible to authorised officers at any reasonable time.
- (2.H3) Determinations of the quality of contaminants released to waters to check conformity with the release quality characteristics specified in Table 1 of Schedule 2.C of this environmental authority must be undertaken on samples collected from the sampling point specified in condition number (2.H2).

Section 45(1)

Schedule 2.H - Table 1

Quality Characteristic Determination	Frequency
5-day Biochemical Oxygen Demand	quarterly
Suspended Solids	quarterly
Faecal Coliforms (Organisms/100 ml)	quarterly
pH	quarterly
Dissolved Oxygen	quarterly
Ammonia Nitrogen	quarterly

Environmental Impact Monitoring

- (2.H4) The holder of this environmental authority must, on each occasion that the effluent from the sewage treatment plant is sampled in accordance with this environmental authority, monitor the quality of the waters of Kappa Creek in accordance with the following requirements:
- (a) obtain a grab sample or samples of water at two (2) sampling points, one upstream and one downstream of the effluent discharge point to the creek; and
 - (b) any sample(s) collected must be analyzed, by field tests where appropriate, for the concentrations of all of the quality characteristics listed in Schedule 2.H, Table 1.

Monitoring of Volume of Release

- (2.H5) The daily quantity of contaminants released must be determined by the use of a flowmeter. Any works required to achieve compliance with this condition must be completed by 1 March 1999.
- (2.H6) Records must be kept of the results of all determinations of the daily quantity of contaminants released to waters.

Contaminant Removal from Sewage Treatment Plant Effluent

- (2.H7) The holder of this environmental authority must, before 31 May 1999 submit a report to the administering authority on the results of an investigation into options for the significant reduction of the amount of nutrients and other contaminants discharged to Kappa Creek from the Yarrabah sewage treatment plant. This report must include details of the options assessed, their advantages and disadvantages (including the results of any comparative scoring process) and a timetable for any proposed works.

END OF CONDITIONS FOR SCHEDULE 2.H

Section 45(1)

SCHEDULE 2.I - DEFINITIONS


- (2.11) "licensed place" in this part of this environmental authority means the Yarrabah Sewage Treatment Plant on Plan NR7310, Parish of Trinity, County of Nares and located at King Beach Road, Yarrabah Qld 4871 at the location shown in the site plan included in condition number (1.J1) and includes any pump stations, reticulation systems and other ancillary works associated with the plant.
- (2.12) "dry weather day" refers to a day during which no rain falls within the catchment of the sewage treatment plant from the commencement of measurement for that day. The term also excludes days during which measurement is made which occur within three (3) days following cumulative rainfall of 100 mm over the three (3) preceding days.
- (2.13) "wet weather day" refers to any day other than a dry weather day.
- (2.14) "ADWF" means average dry weather flow.

END OF CONDITIONS FOR SCHEDULE 2.I

Section 45(1)


SCHEDULE 2.J - SITE PLAN

(2.J1) Yarrabah Sewage Treatment Plant - Site Plan and Location of Discharge Point
W1 and Southern Pump Stations

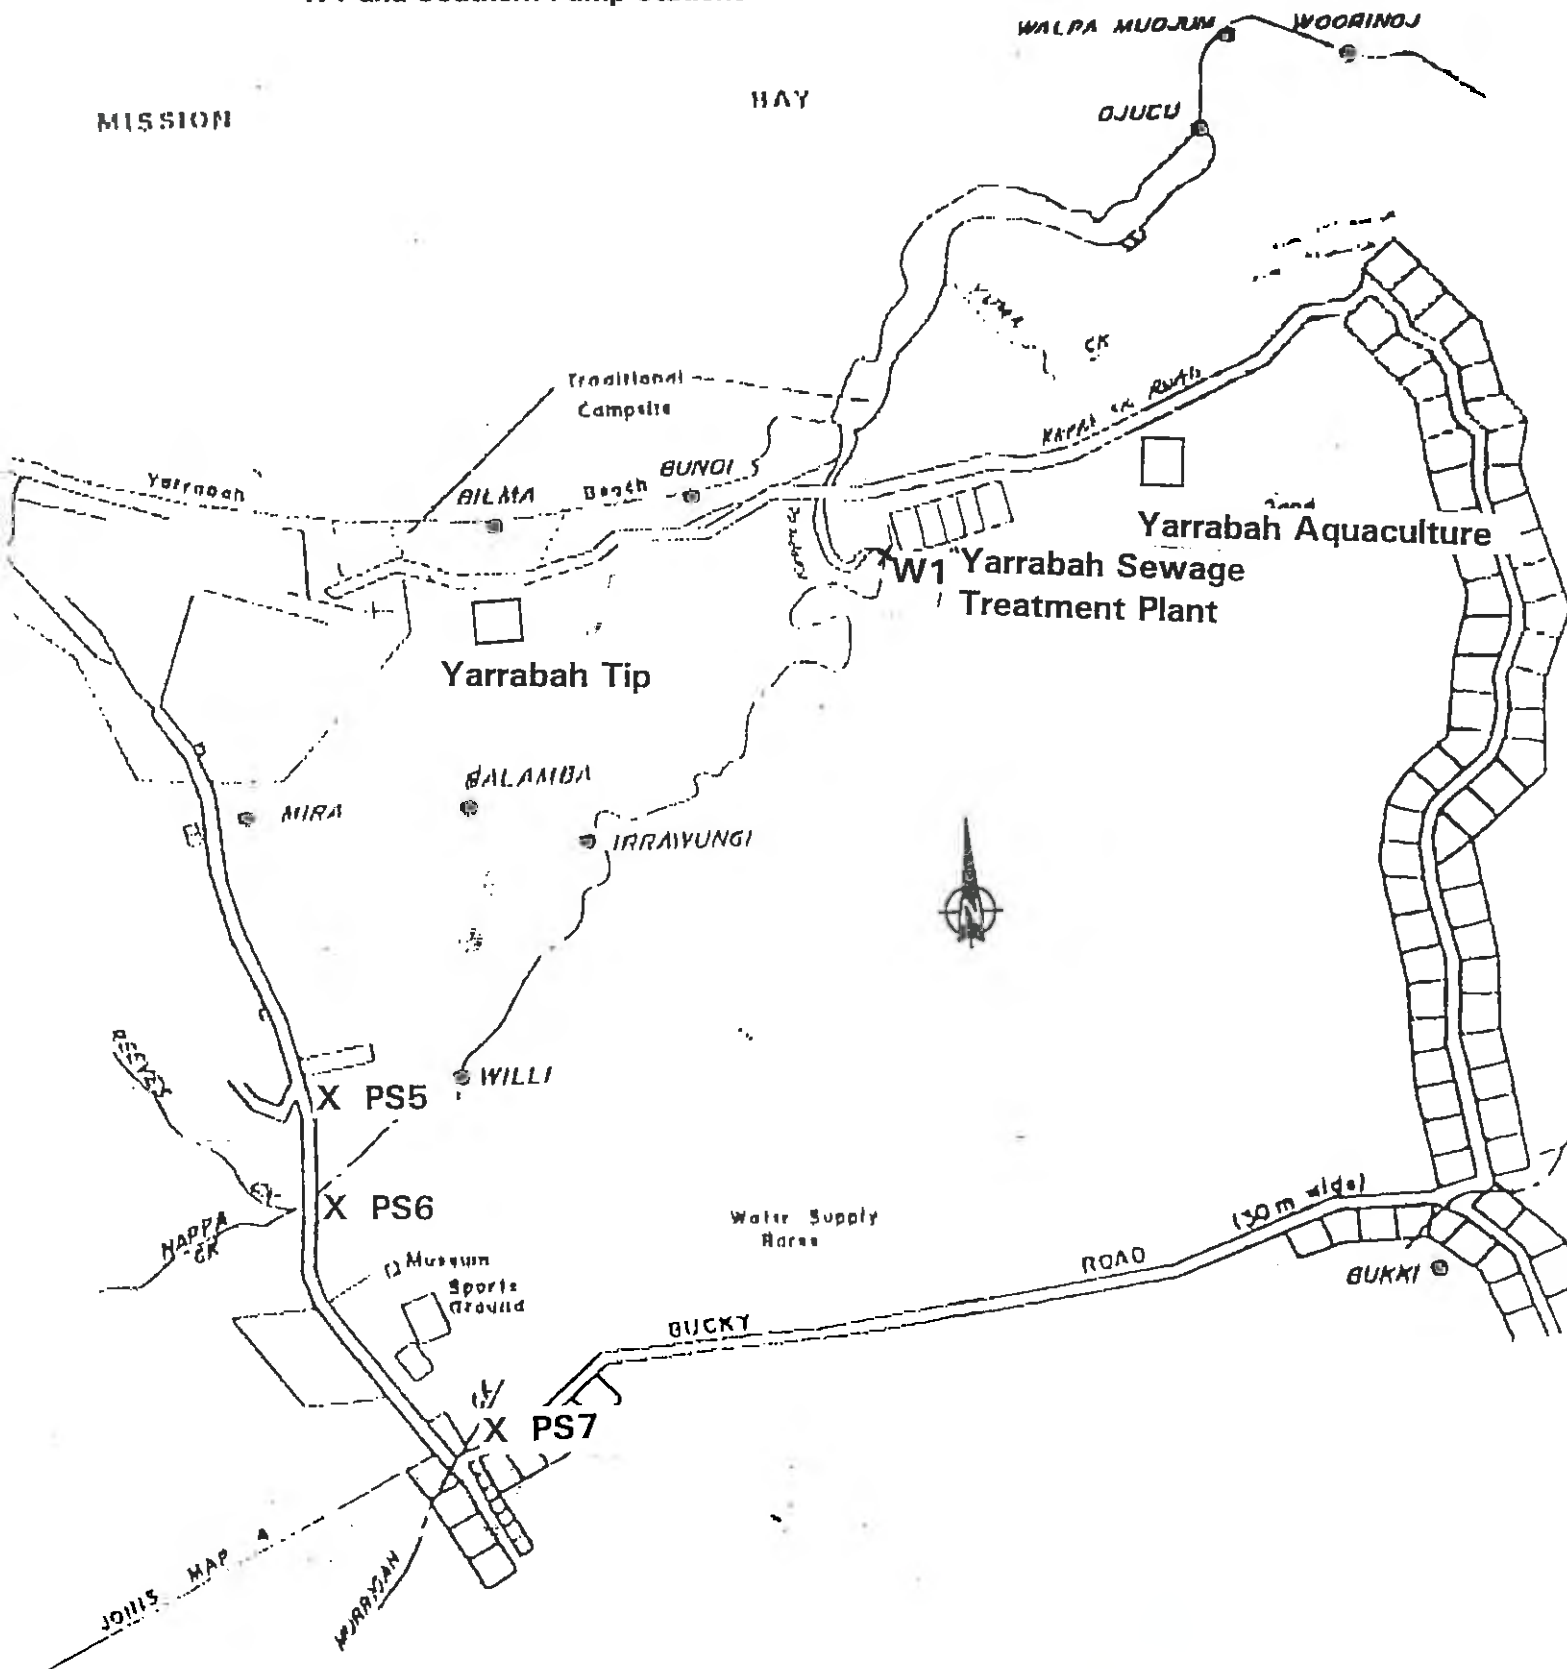

Section 45(1)

(2.J2) Yarrabah Sewage Treatment Plant - Location of Northern Pump Stations and
Overflows

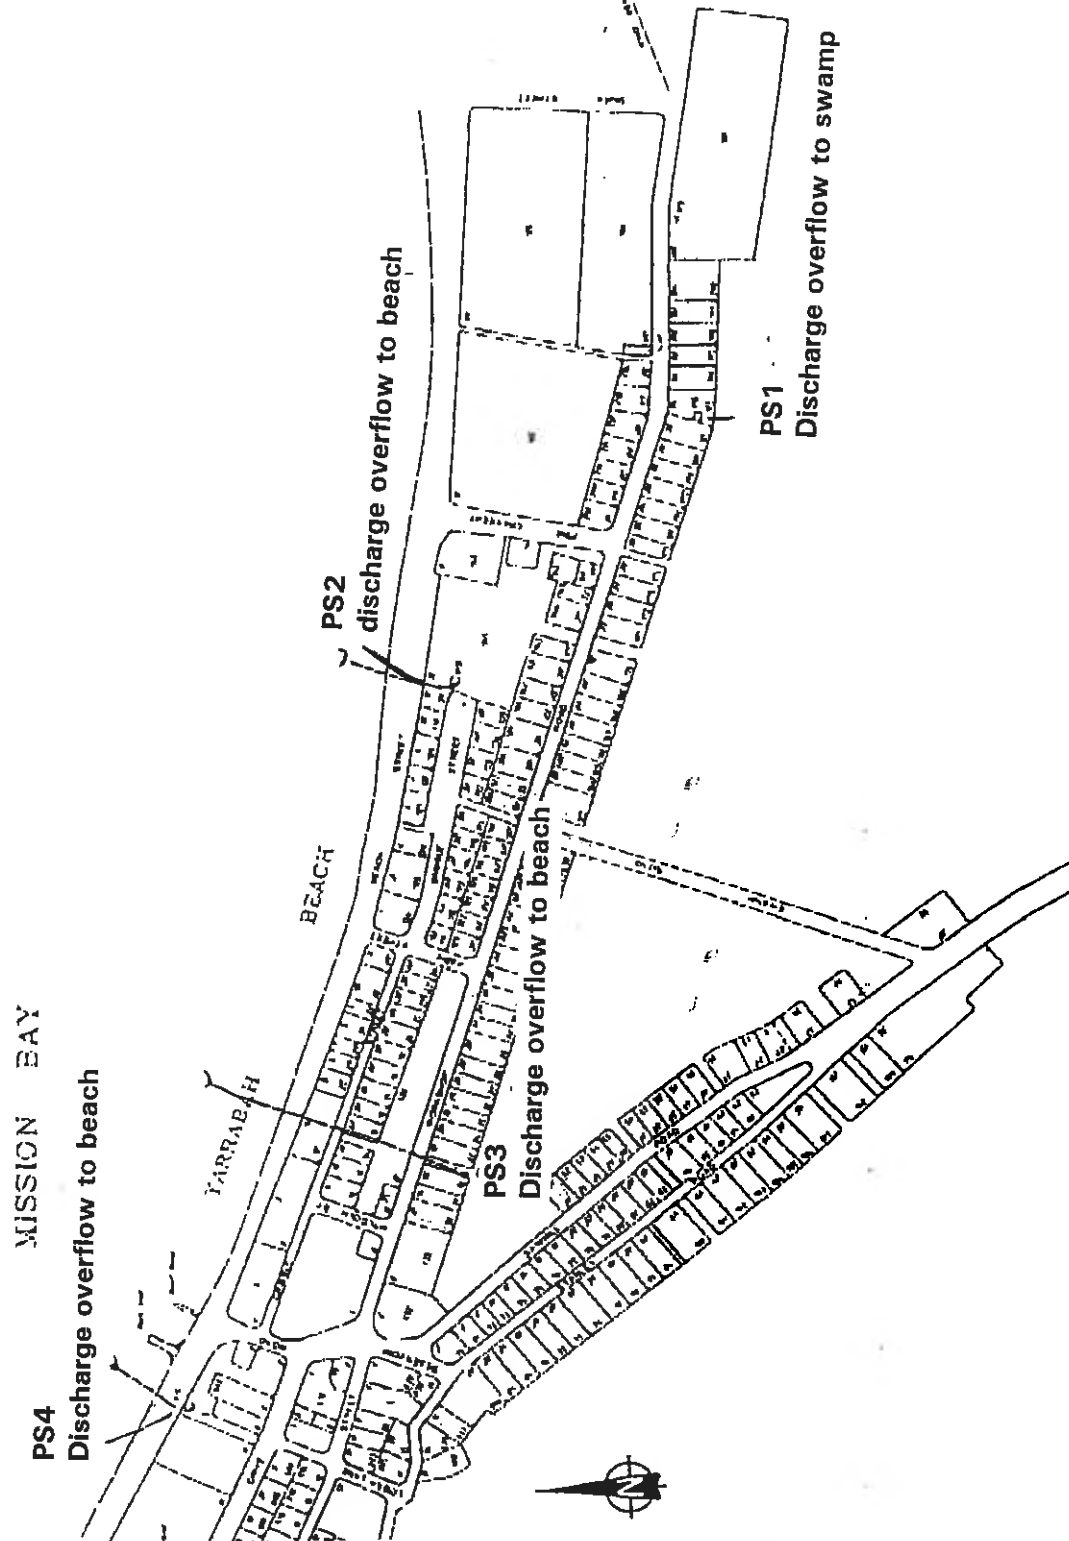

END OF CONDITIONS FOR SCHEDULE 2.J

Section 45(1)

PART 3 - YARRABAH TIP

SCHEDULE 3.A - GENERAL CONDITIONS

Site Development Plan

- (3.A1) The holder of this environmental authority must prepare and submit to the administering authority Site Development Plans for the Yarrabah Tip to cover each five (5) year period from the date this environmental authority is issued or until a Post Closure Care Plan has been implemented. Each Site Development Plan must be finalised and submitted at least three (3) months before the expiry of the previous plan and must include details of at least the following:
- (a) the location and accurate dimensions of any designated areas to be used for the disposal and storage of waste at the licensed place over the period covered by the Site Development Plan; and
 - (b) any area of the licensed place where precautions are taken in respect of disposal of a particular waste must be marked on the Site Development Plan as soon as practicable after the waste has been disposed of. The following information also needs to be recorded in respect of that waste:
 - (i) a description of the waste; and
 - (ii) the accurate location and depth and dimensions of the area in which this waste was disposed; and
 - (iii) date the waste was deposited; and
 - (c) where applicable, accurate location of any leachate storage tank, dam or pond, pump well, collection and disposal system installed on the licensed place; and
 - (d) location of any stormwater drains or diversion embankments to be constructed to achieve compliance with this environmental authority; and
 - (e) location of any area to be capped, the proposed final surface levels and contours, and the final drainage system as part of a rehabilitation program for the licensed place over the period covered by this Site Development Plan.

Waste Acceptance Criteria

- (3.A2) This environmental authority permits only the following wastes to be received for disposal at the licensed place:
- (a) construction wastes and demolition waste;
 - (b) limited regulated waste as defined in the Environmental Protection Regulation 1998;
 - (c) solid inert waste;
 - (d) domestic garbage; and
 - (e) green wastes.

Section 45(1)

Note:

- (i) drums containing any residual regulated wastes are themselves a regulated waste and must not be received for disposal at the licensed place unless they have been steam cleaned, triple rinsed or thoroughly cleaned.
- (ii) car bodies and recyclable solid inert wastes may be stored on the licensed place.

Wastes Prohibited for Disposal

- (3.A3) Notwithstanding condition number (3.A2), the following wastes must not be disposed of on the licensed place:
- (a) pyrophoric wastes (where co-disposed with other potentially combustible material); or
 - (b) explosives and ammunition, pyrotechnics or propellants, apart from trace residues no longer capable of supporting combustion or an explosive reaction; or
 - (c) liquescent waste streams or any waste capable of yielding free liquids; or
 - (d) untreated infectious wastes; or
 - (e) regulated wastes other than those permitted under condition number (3.A2).

Supervision

- (3.A4) The holder of this environmental authority must ensure that the licensed place is inspected as often as is necessary so as to ensure compliance with this environmental authority, but in any case not less frequently than once per week.

Site Relocation Report

- (3.A5) By 1 March 1999 the holder of this environmental authority must submit to the administering authority a report on the results of an investigation into alternative sites for the Yarrabah Tip.

Closure and Post Closure Care Plan

- (3.A6) The holder of this environmental authority must develop a Closure and Post Closure Care Plan for the the Yarrabah Tip on Workshop Road, Yarrabah which extends for a nominal period of thirty (30) years after cessation of waste disposal activities and continues in effect until it can be demonstrated to the administering authority that the area used for waste disposal will not release contaminants to the environment.

Section 45(1)

- (3.A7) The Closure and Post Closure Care Plan must include, but not necessarily be limited to the following:
- (a) proposed after use of any area used for waste disposal; and
 - (b) maintenance of stormwater diversion away from any area previously used for waste disposal; and
 - (c) maintenance of the integrity and effectiveness of final cover systems on any area used for waste disposal.; and
 - (d) maintenance and operation of any leachate collection system installed as part of the Closure Plan; and
 - (e) the continuation of a monitoring program if required under this environmental authority; and
 - (f) maintenance of vegetation planted on the completed, capped and drained disposal areas.
- (3.A8) At least six (6) months before the cessation of waste disposal activities at the Yarrabah Tip on Workshop Road, Yarrabah the holder of this environmental authority must submit the Closure and Post Care Plan to the administering authority for review and comment.

END OF CONDITIONS FOR SCHEDULE 3.A

SCHEDULE 3.B - AIR

Odour Generation

- (3.B1) In the event of a complaint made to the administering authority (which is neither frivolous or vexatious) about odour generated on the licensed place, and the odour is considered by the administering authority to be an unreasonable release, the holder of this environmental authority must take action to mitigate the odour to ensure that it is no longer an unreasonable release.

Dust Generation

- (3.B2) In the event of a complaint made to the administering authority (which is neither frivolous or vexatious) about dust generated on the licensed place, and the release of dust is considered by the administering authority to be unreasonable, the holder of this environmental authority must take action to mitigate the release of dust to ensure that it is no longer unreasonable.

Dust Control

- (3.B3) Any stockpiles of inert cover material must be managed so as to minimise wind blown dust emissions.
- (3.B4) The holder of this environmental authority must ensure that all wastes accepted onto the licensed place are handled, disposed of or stockpiled in such a way as to minimise dust generation.

END OF CONDITIONS FOR SCHEDULE 3.B

Section 45(1)

SCHEDULE 3.C - WATER

- (3.C1) The holder of this environmental authority must not either directly or indirectly release any leachate generated on the licensed place to any land beyond the boundary of the licensed place or to any stormwater drain or waters.

END OF CONDITIONS FOR SCHEDULE 3.C

SCHEDULE 3.D - STORMWATER MANAGEMENT

Stormwater Diversion

- (3.D1) A system of suitable diversion drains or embankments must be constructed and maintained to divert surface waters away from any area of the licensed place where contact with wastes or contaminants may occur. Particular attention must be paid to:
- (a) any active waste disposal area;
 - (b) any waste storage areas;
 - (c) any area previously used for waste disposal; and
 - (d) any leachate collection ponds (if applicable).

END OF CONDITIONS FOR SCHEDULE 3.D

SCHEDULE 3.E - LAND APPLICATION

- (3.E1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 3.E

SCHEDULE 3.F - NOISE

- (3.F1) Nil conditions.

END OF CONDITIONS OF SCHEDULE 3.F

SCHEDULE 3.G - WASTE MANAGEMENT

General

- (3.G1) The holder of this environmental authority must not:
- (a) burn waste at or on any licensed place covered by this environmental authority unless otherwise authorised by this administering authority; nor
 - (b) allow waste to burn or be burnt at or on any licensed place covered by this environmental authority unless otherwise authorised by the administering authority; nor
 - (c) remove waste from any licensed place covered by this environmental authority and burn such waste elsewhere except in accordance with the requirements of the Environmental Protection Act 1994.

Section 45(1)

Compliance with Site Development Plan

- (3.G2) The holder of this environmental authority must ensure waste disposal activities are carried out in accordance with the Site Development Plan required under condition number (3.A1) of this environmental authority.

Soil Permeability

- (3.G3) Any future waste disposal area, leachate storage pond and above ground embankment on the licensed place must be constructed to a standard which effectively minimises the release of leachate through the base and embankments.

Removal of Cover Material

- (3.G4) Where waste is to be disposed of above an area previously used for waste disposal, existing cover material must be ripped or removed so as to allow leachate and contaminated stormwater to percolate through the wastes deposited below.

Access to Active Waste Disposal Area

- (3.G5) The holder of this environmental authority must ensure any waste disposal area constructed on the licensed place is constructed with ramps, where necessary, to allow plant and machinery access to the active waste disposal area, so that wastes can be effectively consolidated, compacted and covered.

Maintenance of Embankments

- (3.G6) The perimeter embankments of any disposal area or leachate storage pond installed on the licensed place must be maintained so as to ensure the stability and integrity of their construction.

Leachate Management

- (3.G7) The holder of this environmental authority must ensure that all reasonable and practical measures are taken to ensure all active waste disposal areas are operated and managed so as to minimise the generation of leachate.

Leachate Disposal

- (3.G8) The holder of this environmental authority may only dispose of leachate or contaminated stormwater generated on the licensed place:
- (a) by evaporation on the licensed place; or
 - (b) by recirculation back into the areas of the licensed place where waste disposal is taking place; or
 - (c) by irrigation over exposed wastes on the licensed place.
- (3.G9) Leachate must not be disposed of on any area of the licensed place that has received its final cover of topsoil or on any revegetated areas unless the quality of the leachate is such that it will not cause any environmental harm through soil contamination or damage to vegetation.

Section 45(1)

Active Waste Disposal Area Management

- (3.G10) The holder of this environmental authority must ensure that waste disposal activities do not extend beyond the boundary of the licensed place.
- (3.G11) The holder of this environmental authority must take effective measures to ensure that all wastes received for disposal at the licensed place are not disposed of:
- (a) beyond any active waste disposal area; or
 - (b) into waters or leachate collected at the base of any active waste disposal area; and
 - (c) beyond the catchment of any leachate collection drains installed as part of a leachate collection system.
- (3.G12) All large metal articles received for disposal must be effectively compacted before being deposited at the base of any active waste disposal area.

Availability of Cover Material

- (3.G13) The holder of this environmental authority must ensure that a stockpile of cover material in sufficient quantities to cover waste disposed on the licensed place over any one (1) month period is readily accessible at all times.

Covering of Wastes

- (3.G14) Wastes deposited in any active waste disposal area must be effectively consolidated, compacted and covered with a layer of inert earthen material or other non-combustible, inert material to prevent exposure of covered wastes as often as is necessary to:
- (a) prevent the access of flies, rodents, or other animals to covered wastes; and
 - (b) minimise the propagation of odours from deposited wastes; and
 - (c) minimise the generation of windblown litter; and
 - (d) reduce the risk of fire; and
 - (e) ensure compliance with the conditions of this environmental authority, but in any case not less frequently than once per week.

Mechanical Plant

- (3.G15) Mechanical plant capable of ensuring compliance with this environmental authority must be used to carry out any consolidation, compaction and covering of wastes deposited in any active waste disposal area.

Tyre Storage

- (3.G16) Waste tyres may be stored in temporary above ground heaps on the licensed place provided that there are no more than 500 waste tyres at any time in any one (1) heap.

Section 45(1)

(3.G17) Where there is more than one heap of waste tyres, a separation distance between the heaps or other methods must be established and maintained so as to effectively prevent fire from spreading:

- (a) from one (1) tyre storage heap to another; and
- (b) to other waste stored or disposed of at the licensed place.

Access Roads

(3.G18) The holder of this environmental authority must ensure all weather access roads are constructed and maintained so that at all times whilst the licensed place is open for receiving wastes, vehicles have access to any active waste disposal area.

Signs

(3.G19) The holder of this environmental authority must cause signs, maintained in good repair, to be erected at the entrance to the licensed place and/or in prominent locations on the licensed place. Such signs must give the following information at a minimum:

- (a) the wastes permitted to be received at the licensed place; and
- (b) prohibition of the lighting of unauthorised fires on the licensed place; and
- (c) directing traffic to the location of the active disposal area.

Fencing

(3.G20) Fences and barriers must be erected and maintained at the licensed place so as to prevent stock access to any active waste disposal area.

Litter Control

(3.G21) Where necessary, relocatable litter screens or other methods of litter control must be provided at the active disposal area in order to effectively capture paper or other wind blown litter generated by waste disposal activities on the licensed place.

(3.G22) The holder of this environmental authority must ensure litter is collected so as to ensure that the licensed place, all fences, litter screens and the surrounds of the licensed place are kept in a tidy condition.

Public Health Issues

(3.G23) The holder of this environmental authority must make provision to ensure that the operation of the Yarrabah Tip does not create a public health problem and must carry out any works required by the administering authority to prevent or abate any public health problem or nuisance which may arise as a result of the operation of the licensed place.

(3.G24) The holder of the environmental authority must take all practical measures to ensure that the environmentally relevant activity is conducted at all times in a nuisance free manner, particularly regarding fly breeding, mosquito breeding and rat harbourage and breeding.

Section 45(1)

Fire Control

- (3.G25) The holder of this environmental authority must ensure a fire break is maintained around any active waste disposal area so as to prevent the spread of fire to adjoining land.
- (3.G26) In the event of any fire occurring at the licensed place the holder of this environmental authority must extinguish the fire, as soon as it is safe to do so.

Final Cover

- (3.G27) Any completed waste disposal area must be capped with low permeability material and compacted so as to effectively minimise infiltration of stormwater.
- (3.G28) Any completed and capped waste disposal area must be progressively covered with clean earth to a depth of at least 250 millimetres capable of supporting shallow rooted vegetation. A thicker top soil layer may be necessary to support deeper rooted vegetation and also to prevent root penetration of the cap.
- (3.G29) The final surface of any completed disposal area of the licensed place must, after covering as specified in condition number (3.G28) be graded, drained and vegetated so as to:
- (a) minimise erosion; and
 - (b) divert clean stormwater away from the completed disposal area; and
 - (c) prevent ponding of stormwater.
- (3.G30) In the areas awaiting rehabilitation or those in the process of being rehabilitated, vehicle access must be restricted by suitable barriers to prevent surface disturbance.

END OF CONDITIONS FOR SCHEDULE 3.G

SCHEDULE 3.H - MONITORING AND REPORTING

- (3.H1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 3.H

SCHEDULE 3.I - DEFINITIONS

For the purposes of this environmental authority the following definitions apply:


- (3.I1) "licensed place" in this part of this environmental authority means the Yarrabah Tip, on Plan NR7310, Parish of Trinity, County of Nares and located at Workshop Street, Yarrabah Qld 4871 at the location shown in the site plan attached as condition number (3.J1).
- (3.I2) "active waste disposal area " means an area or trench currently being used for the disposal of wastes accepted under a condition of this environmental authority and includes all or part of a disposal trench.

END OF CONDITIONS FOR SCHEDULE 3.I

Section 45(1)

SCHEDULE 3.J - SITE PLAN

(3.J1) Yarrabah Tip - Location of Licensed Place.

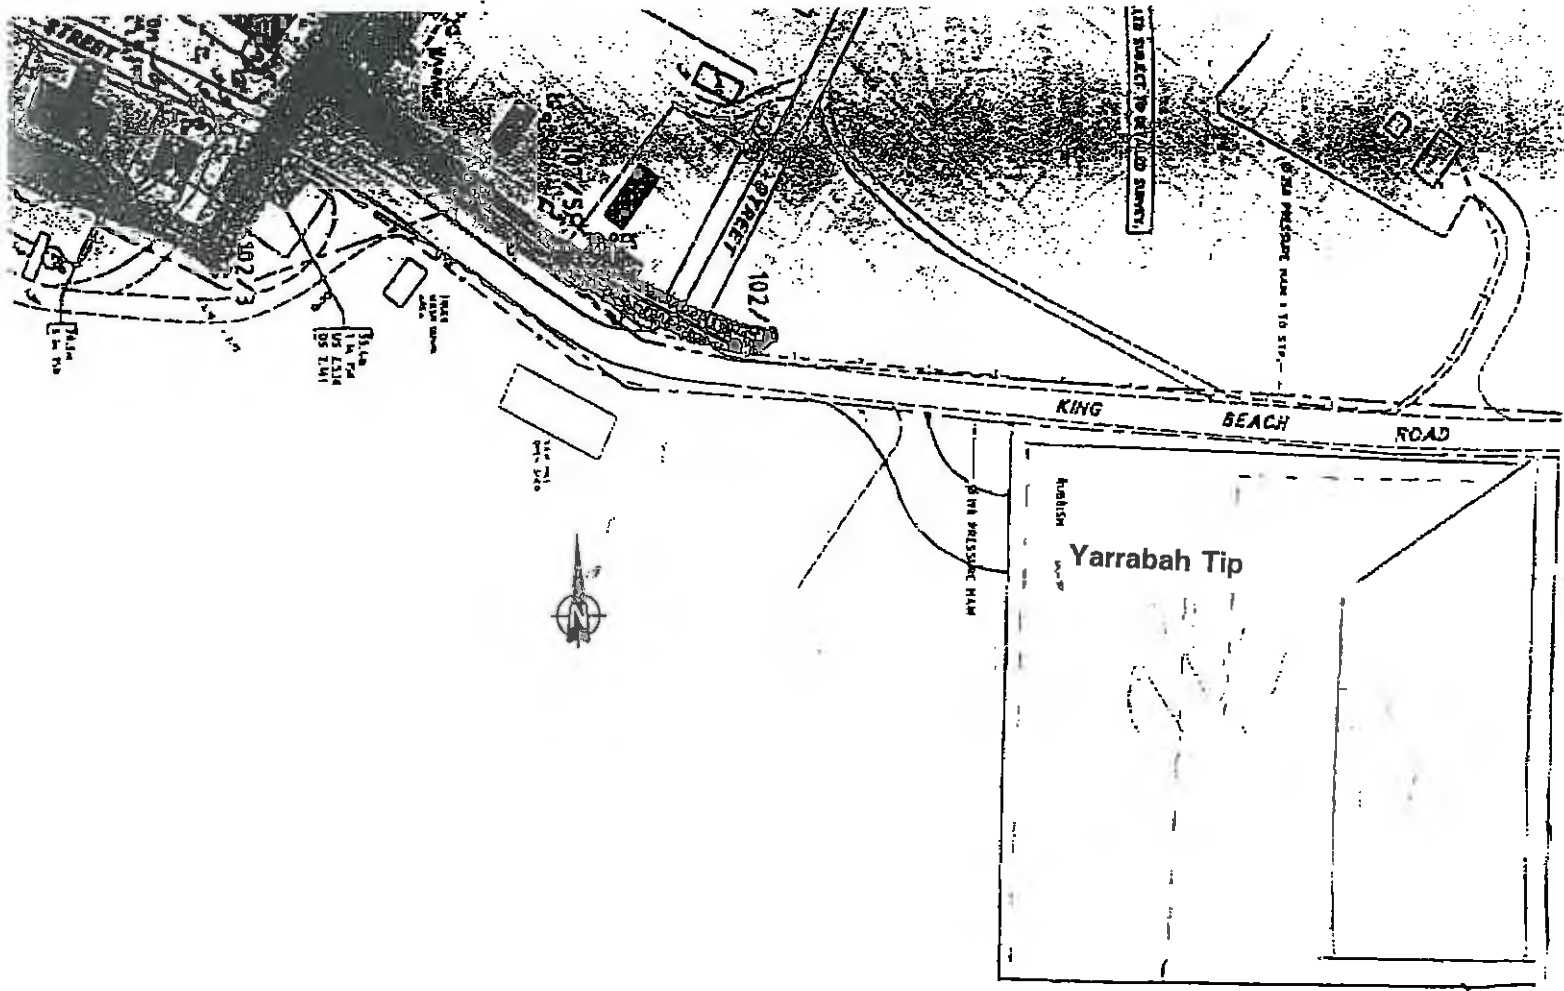

END OF CONDITIONS FOR SCHEDULE 3.J

Section 45(1)

PART 4 - YARRABAH AQUACULTURE FARM

SCHEDULE 4.A - GENERAL CONDITIONS

(4.A1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 4.A

SCHEDULE 4.B - AIR

(4.B1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 4.B

SCHEDULE 4.C - WATER

Release of Contaminants to Waters

(4.C1) The only contaminants permitted to be released from the licensed place at the Release Point W2 are effluent from the aquaculture ponds.

Release Points

(4.C2) Contaminants that may cause environmental harm must not be directly or indirectly released from any source on the licensed place to any waters at any location other than the discharge at release point W2 of wastewater from the aquaculture facility to waters described as Kappa Creek at 0.6 km AMTD.

Quantity of Contaminants Released

(4.C3) The total quantity of contaminants released from Release Point W2 during any day must not exceed 4356 cubic metres at a pumping rate of not greater than forty (40) litres per second.

Quality Characteristics Of Release to Waters

(4.C4) The release of contaminants to waters must comply, at the sampling and in situ measurement point specified in Schedule 4.H, with each of the limits specified in schedule 4.C Table 1 for each quality characteristic.

(4.C5) The release must not produce any slick or other visible evidence of oil or grease, nor contain visible floating oil, grease, scum, litter or other objectionable matter.

Schedule 4.C - Table 1

Release Quality Characteristic Limits

Quality Characteristics	Discharge Limit	Limit Type
5-day Biochemical Oxygen Demand (mg/l)	20	Maximum
Suspended Solids (mg/l)	30	Maximum
pH (pH Units)	6.5 - 8.5	Range
Dissolved Oxygen (mg/l)	2.0	Minimum
Total Nitrogen (mg/l)	2.0	Maximum

END OF CONDITIONS FOR SCHEDULE 4.C

Section 45(1)

SCHEDULE 4.D - STORMWATER MANAGEMENT

(4.D1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 4.D

SCHEDULE 4.E - LAND APPLICATION

(4.E1) Nil conditions.

END OF CONDITIONS FOR SCHEDULE 4.E

SCHEDULE 4.F - NOISE

(4.F1) Nil conditions

END OF CONDITIONS OF SCHEDULE 4.F

SCHEDULE 4.G - WASTE MANAGEMENT

(4.G1) Nil conditions.

END OF CONDITIONS OF SCHEDULE 4.G

SCHEDULE 4.H - MONITORING AND REPORTING

Monitoring of Contaminant Releases to Waters

(4.H1) The holder of this environmental authority is responsible for the making of determinations and keeping of records of the quality of the contaminants released for the release point, quality characteristics, and at the frequency specified in Schedule 4.H Table 1.

Sampling and Monitoring Point Details

(4.H2) Determinations of the quality of contaminants released to waters to check conformity with the release quality characteristics specified in Table 1 of Schedule 4.C of this environmental authority must be undertaken on samples of the effluent discharged from the aquaculture ponds to Kappa Creek at release point W2.

Monitoring Of Volume of Release

(4.H3) The daily quantity of contaminants released must be determined by a method which is accurate to within 10% of the actual amount released.

(4.H4) Records must be kept of the results of all determinations of the daily quantity of contaminants released to waters.

Section 45(1)

Schedule 4.H - Table 1

Quality Characteristic Determination	Frequency
5-day Biochemical Oxygen Demand (mg/l)	quarterly
Suspended Solids (mg/l)	quarterly
pH (pH Units)	quarterly
Dissolved Oxygen (mg/l)	quarterly
Total Nitrogen (mg/l)	quarterly

END OF CONDITIONS FOR SCHEDULE 4.H

SCHEDULE 4.I - DEFINITIONS

For the purposes of this environmental authority the following definitions apply:

- (4.I1) "licensed place" in this part of this environmental authority means the Yarrabah Aquaculture Farm on Plan NR7310, Parish of Trinity, County of Nares and located at King Beach Road, Yarrabah Qld 4871 at the location as shown in the site plan attached as condition number (1.J1).

END OF CONDITIONS FOR SCHEDULE 4.I

END OF ENVIRONMENTAL AUTHORITY