(e) 340530
(pp) 3170623.

Item Id 2113864

NOR/ 044902

ecoaccess
environmental licences and permits

Certificate of Registration

No: ENRE00546906

EPPR00507613

This registration certificate is issued by the Environmental Protection Agency and takes effect from: 20-JUL-2006.

The anniversary day for the purposes of the Annual Return remains: 11 July.

This registration certificate is a requirement of section 73F of the *Environmental Protection Act 1994* and authorises the registered operator to undertake the activity listed below at the following place; subject to the conditions set out in a development approval attached to the premises, or the relevant code of environmental compliance.

Registered Operator:-

Mount Isa Airport Pty Ltd

Barkly Highway
MOUNT ISA QLD 4825

Development Approval Number:-

ENDC00547006

Place:-
Lot 1 Plan RP724915, Lot 14 Plan RP720448, Lot 9 Plan RD48

Located at:-
Barkly Highway,MOUNT ISA QLD 4825.

Registered Activity/ies: -
ERA 15(b) Sewage treatment - operating a standard sewage treatment works having a peak design capacity to treat sewage of 100 or more equivalent persons but less than 1 500 equivalent persons.

Geoff Metcalfe

District Manager
Environmental Protection Agency
21-JUL-2006

Environmental Protection Agency
www.epa.qld.gov.au ABN 87 221 158 786

Queensland Government
Environmental Protection Agency
Queensland Parks and Wildlife Service

(e)3170606 (pp)3170613.

Item Id 2113886

NOR/ 044902

ecoaccess
environmental licences and permits

Permit[1]

S619 Environmental Protection Act 1994

Development Approval for a MCU involving an ERA

Permit number: ENDC00547006

Valid From: 20-JUL-2006

Details

Permit Holder(s)	Name	Address
Principal Holder	Mount Isa Airport Pty Ltd	Barkly Highway MOUNT ISA QLD 4825

Location(s)	Lot and Plan	Activity(s)
Mount Isa Airport Sewage Treatment Plant	1 RP724915 9 RD48 14 RP720448	ERA 15(b) Sewage treatment - operating a standard sewage treatment works having a peak design capacity to treat sewage of 100 or more equivalent persons but less than 1 500 equivalent persons. (15(b) Sewage treatment >100 but <1500 ep1)

Conditions of Approval

Agency interest: General

G1 Prevent and/or Minimise the Likelihood of Environmental Harm.

Notwithstanding any other requirements of this environmental authority, all reasonable and practicable measures must be taken to prevent and/or to minimise the likelihood of environmental harm being caused when carrying out the environmentally relevant activity.

G2 Site-Based Management Plan.

The holder of this environmental authority must update and ensure implementation of the Site-Based Management Plan ensuring it provides for the following:

i) Routine operating procedures to prevent or minimise environmental harm, including procedures for managing the level of treated effluent in the lagoons to prevent/minimise overflows, particularly prior to the onset of the wet season;
ii) Monitoring of the release of contaminants into the environment, including the quality of treated effluent; and
iii) Staff training and awareness of environmental issues.

G3 A copy of the Site-Based Management Plan must be kept in a location readily accessible to personnel carrying out the activity.

G4 Notification.

Notify the administering authority as soon as practicable when the release of contaminants is not in

1 Permit includes licences, approvals, permits, authorisations, certificates, sanctions or equivalent/similar as required by legislation administered by the Environmental Protection Agency and the Queensland Parks and Wildlife Service.

21/7/06

accordance with the conditions of this document or any event where environmental harm may be threatened.

G5 Written advice of the following information must be provided within fourteen (14) days following any event as identified in condition (G4):

- location of the event;
- the time of the event;
- the time the holder of the environmental authority became aware of the event;
- the suspected cause of the event;
- a description of the resulting effects of the event;
- actions taken to mitigate any environmental harm and/or environmental nuisance caused by the event; and
- proposed actions to prevent a recurrence of the event.

G6 Monitoring.

Record, compile and keep all monitoring results required by this document and present this information to the administering authority when requested, in a specified format.

Agency interest: Air

A1 Prevent the release of odours which cause or are likely to cause a nuisance. Nuisance includes the release of contaminants that are likely to be offensive to a person or a nuisance in the opinnion of an authorised person.

Agency interest: Waste

W1 The holder of this environmental authority must ensure that all sludges and treated effluent are directed to the storage lagoons shown in Figures 1 and 2.

W2 Dried sludge generated from the sludge drying ponds must only be disposed of to a facility which can lawfully accept such waste.

Agency interest: Water

WA1 Release of Contaminants to Water.

Contaminants that may cause environmental harm must not be directly or indirectly released from any source on the place to which this licence is related.

WA2 Stormwater Management.

Prevent the release of stormwater runoff that has been in contact with any contaminants at the site to any waters.

WA3 Monitoring.

1 Permit includes licences, approvals, permits, authorisations, certificates, sanctions or equivalent/similar as required by legislation administered by the Environmental Protection Agency and the Queensland Parks and Wildlife Service.

ecoaccess
environmental licences and permits

Permit[1]

Permit number: ENDC00547006

Conduct and keep records of contaminant releases from the release points, frequency, and for the parameters specified in Table 1. All determinants of the quality of contaminants released must be:

- performed by a person or body possessing appropriate experience and qualifications to perform the required measurements; and

- made in accordance with the methods prescribed in the Environmental Protection Agency Water Quality Sampling Manual, 3rd Edition, December 1999, or more recent additions or supplements to that document as such become available.

Signed

Geoff Metcalfe
Environmental Protection Agency
Date 21/7/06


1 Permit includes licences, approvals, permits, authorisations, certificates, sanctions or equivalent/similar as required by legislation administered by the Environmental Protection Agency and the Queensland Parks and Wildlife Service.

21/7/06

Appendix


Figure 1.

Site plan of Mt Isa Airport and Sewage Treatment Plant.

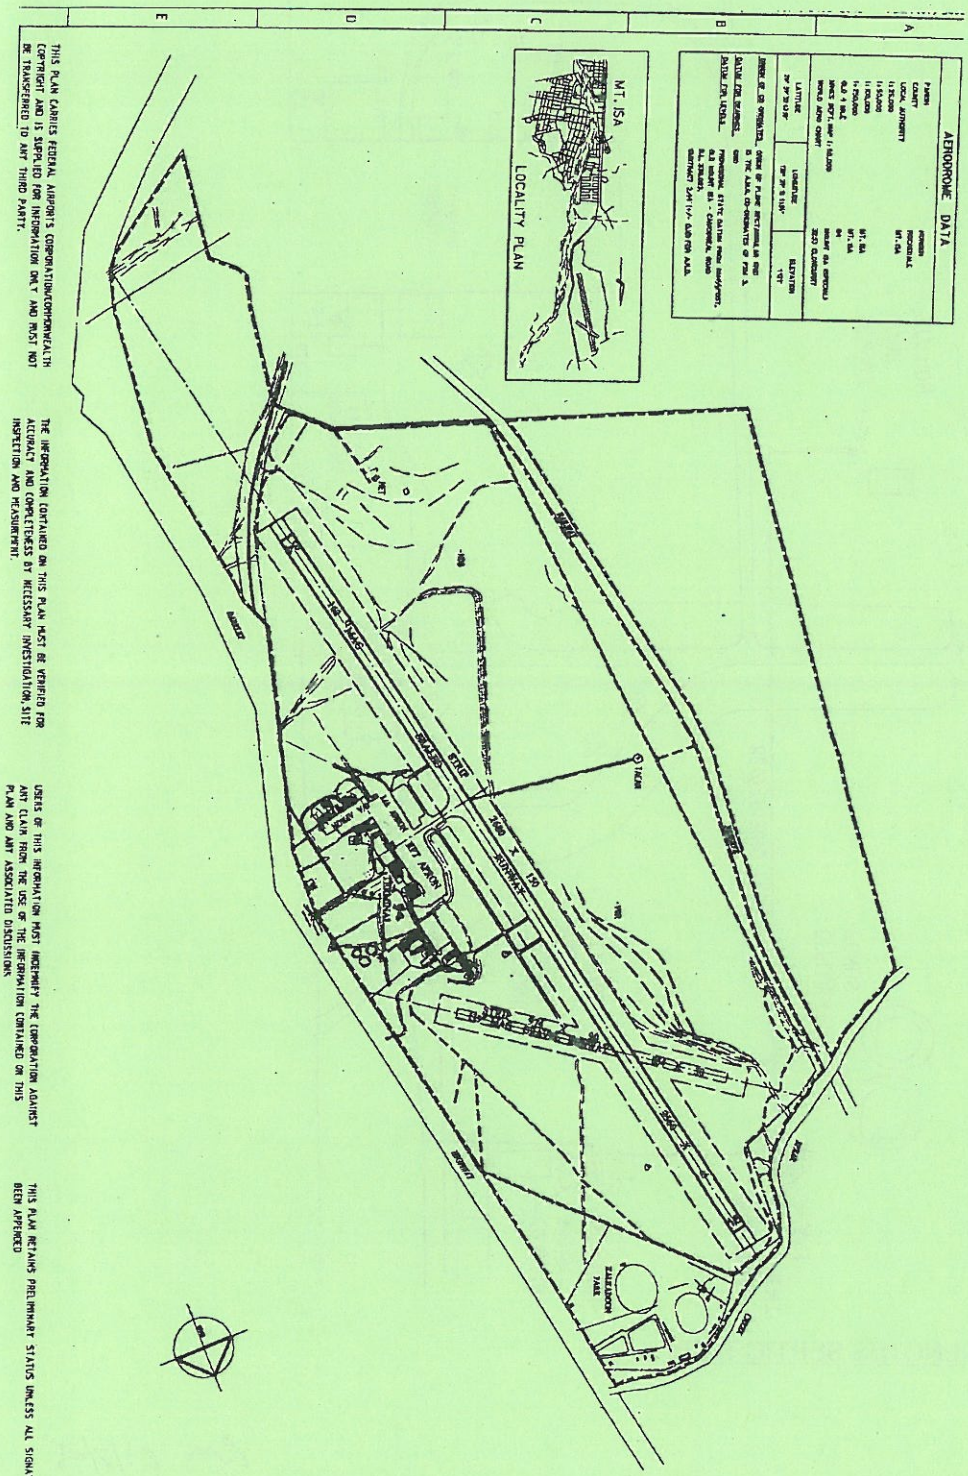

Gm 21/7/08

Figure 2.
Site Plan of Sewerage System Layout.

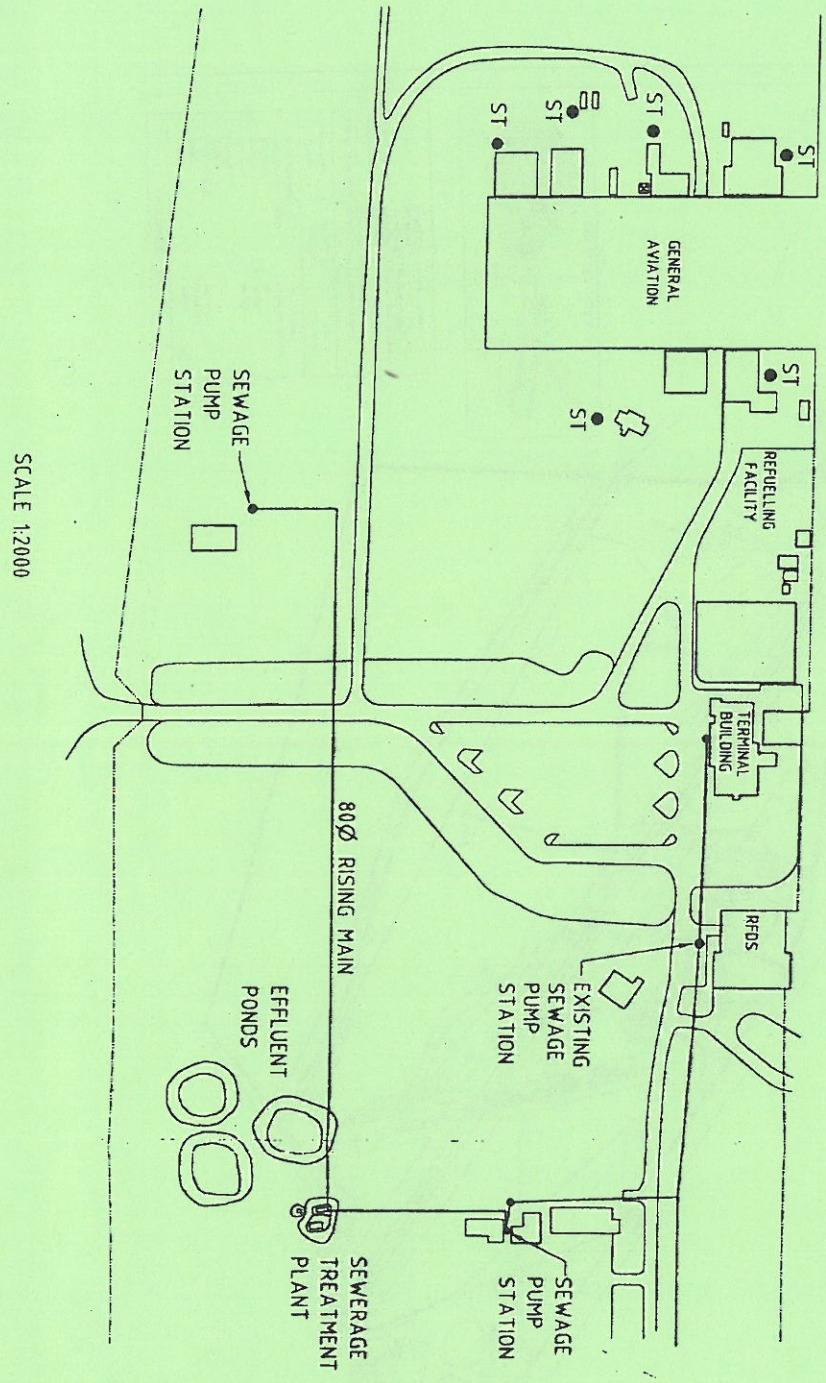

Note: ST - DENOTES SEPTIC TANK

CM 21/7/14

Table 1.

Water Quality Characteristic Limits, Limit Type and Frequency of Sampling.

Quality Characteristics	Release Limits	Limits Type
5-Day Biochemical Oxygen Demand (mg/L)	20	80th Percentile (long term)
	25	80th Percentile (short term)
	60	Maximum
Suspended Solids (mg/L)	30	80th Percentile (long term)
	60	80th Percentile (short term)
	90	Maximum
pH (pH Units)	6.0 to 8.5	Range
Faecal Coliforms (Organisms/100 ml)	1,000	Median
	4,000	80th Percentile (short term)

Frequency	Sample Point
During each flow event	Discharge point from the evaporation lagoons
Every six (6) months	Groundwater monitoring bore (limit type – maximum)

21/7/06